





REPLACES:	CAD/CAM
REVISION DATE:	THE TRANE COMPANY A DIVISION OF AMERICAN STANDARD INC.
DRAWN BY: R. HARRIS	THIS DRAWING IS PROPRIETARY AND SHALL NOT BE COPIED OR ITS CONTENTS DISCLOSED TO OUTSIDE PARTIES WITHOUT THE WRITTEN CONSENT OF THE TRANE COMPANY
DATE: 2-13-96	SIMILAR TO: 2307-8256

FILE NUMBER:	DRAWING NUMBER: 2307-8270
VERTICAL AIR CONDITIONER	
COMMERCIAL SELF CONTAINED	
SCHEMATIC WIRING DIAGRAM (5 OF 5)	
ECE, VO, TCI, IPCB, HI & RHI MODULES	
SCWG, SIWG 20-35 TON & SCRG, SIRG 20-32 TON W/O VFD	

USE COPPER CONDUCTORS ONLY
UNIT TERMINALS ARE NOT DESIGNED
TO ACCEPT ANY OTHER WIRING

⚠ WARNING
HAZARDOUS VOLTAGE!
DISCONNECT POWER BEFORE
SERVICING.

⚠ AVERTISSEMENT
VOLTAGE HASARDEUX!
DECONNECTEZ LA SOURCE ELECTRIQUE
AVANT D'EFFECTUER L'ENTRETIEN.
FAUTE DE DECONNECTER LA SOURCE
ELECTRIQUE AVANT D'EFFECTUER
L'ENTRAINER DES BLESSURES CORPORELLES
SEVERES OU LA MORT.

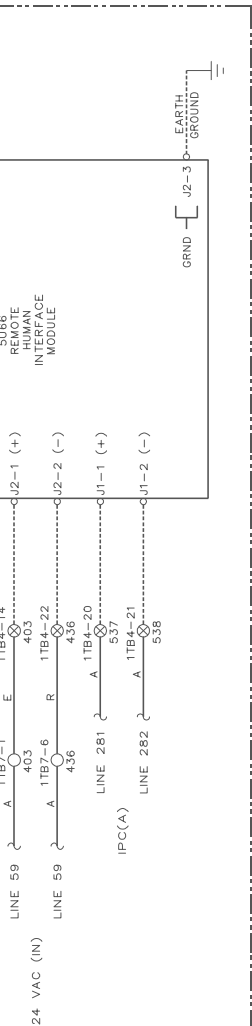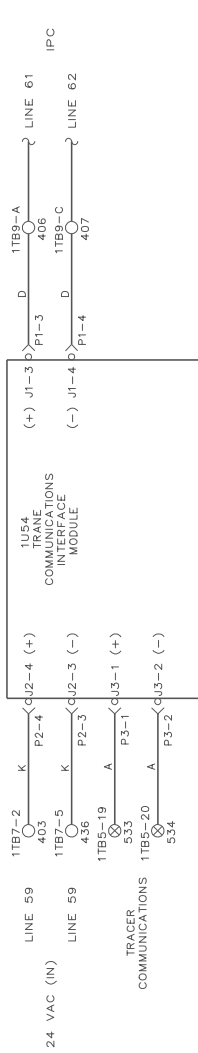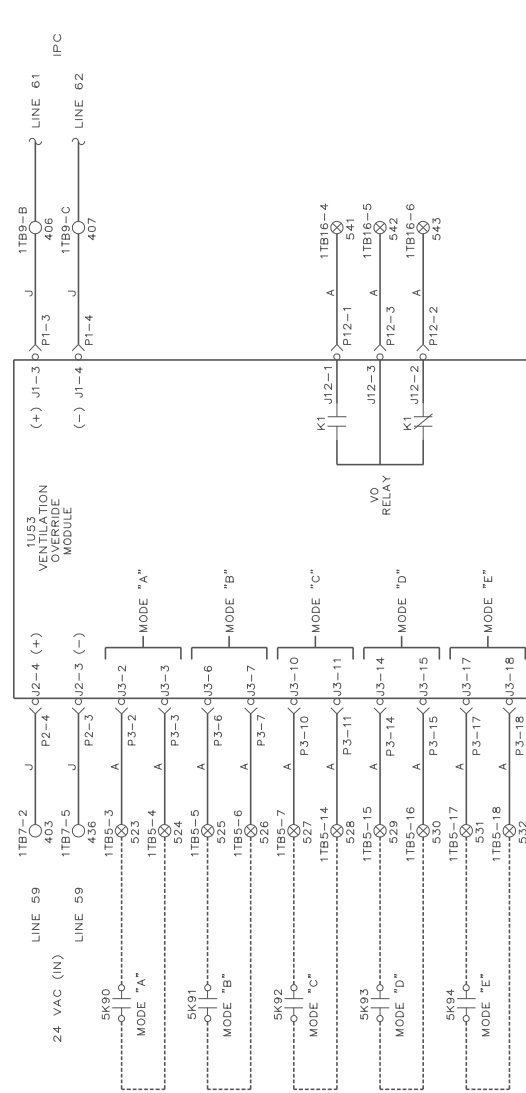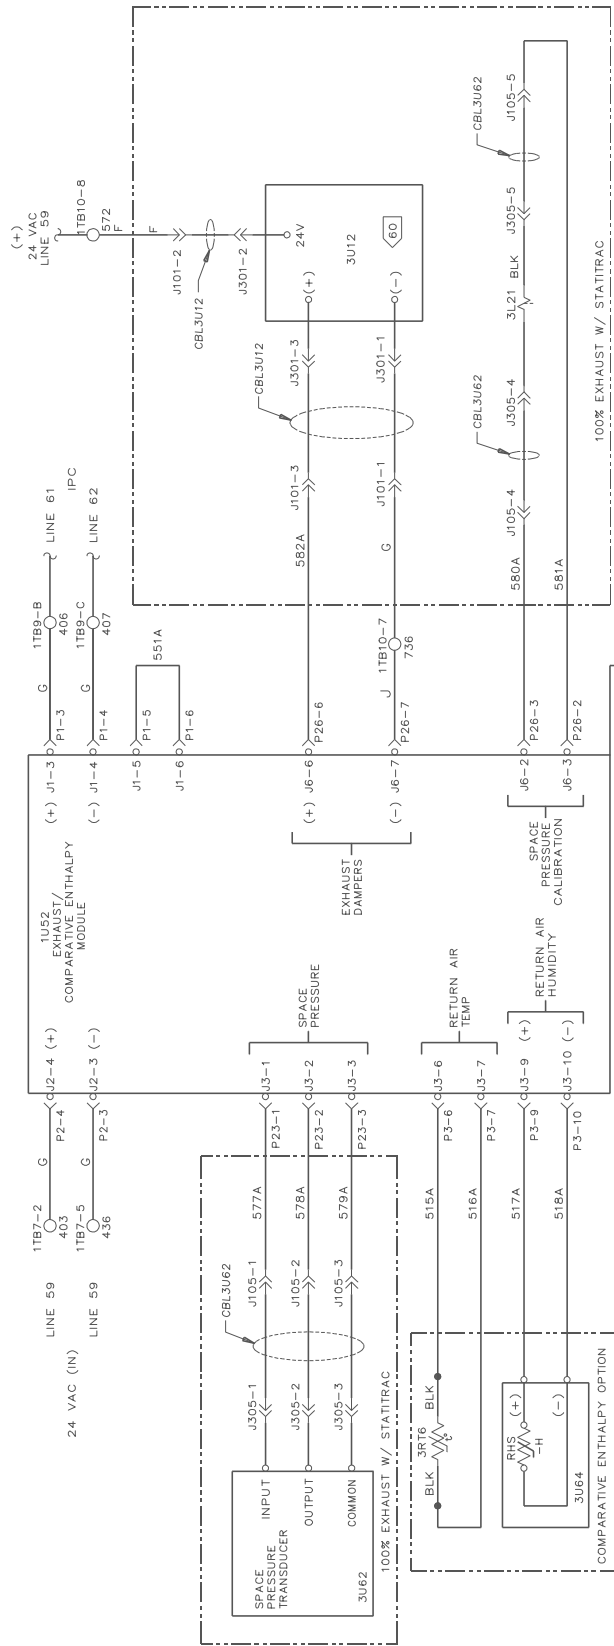

EXHAUST ACTUATOR (3U12) AS SHOWN USED ONLY ON 100% POWER EXHAUST OPTION WITH STATITRAC. REFER TO THE ROOFTOP MODULE (1U48) FOR EXHAUST ACTUATOR CONTROL ON UNITS WITHOUT STATITRAC.