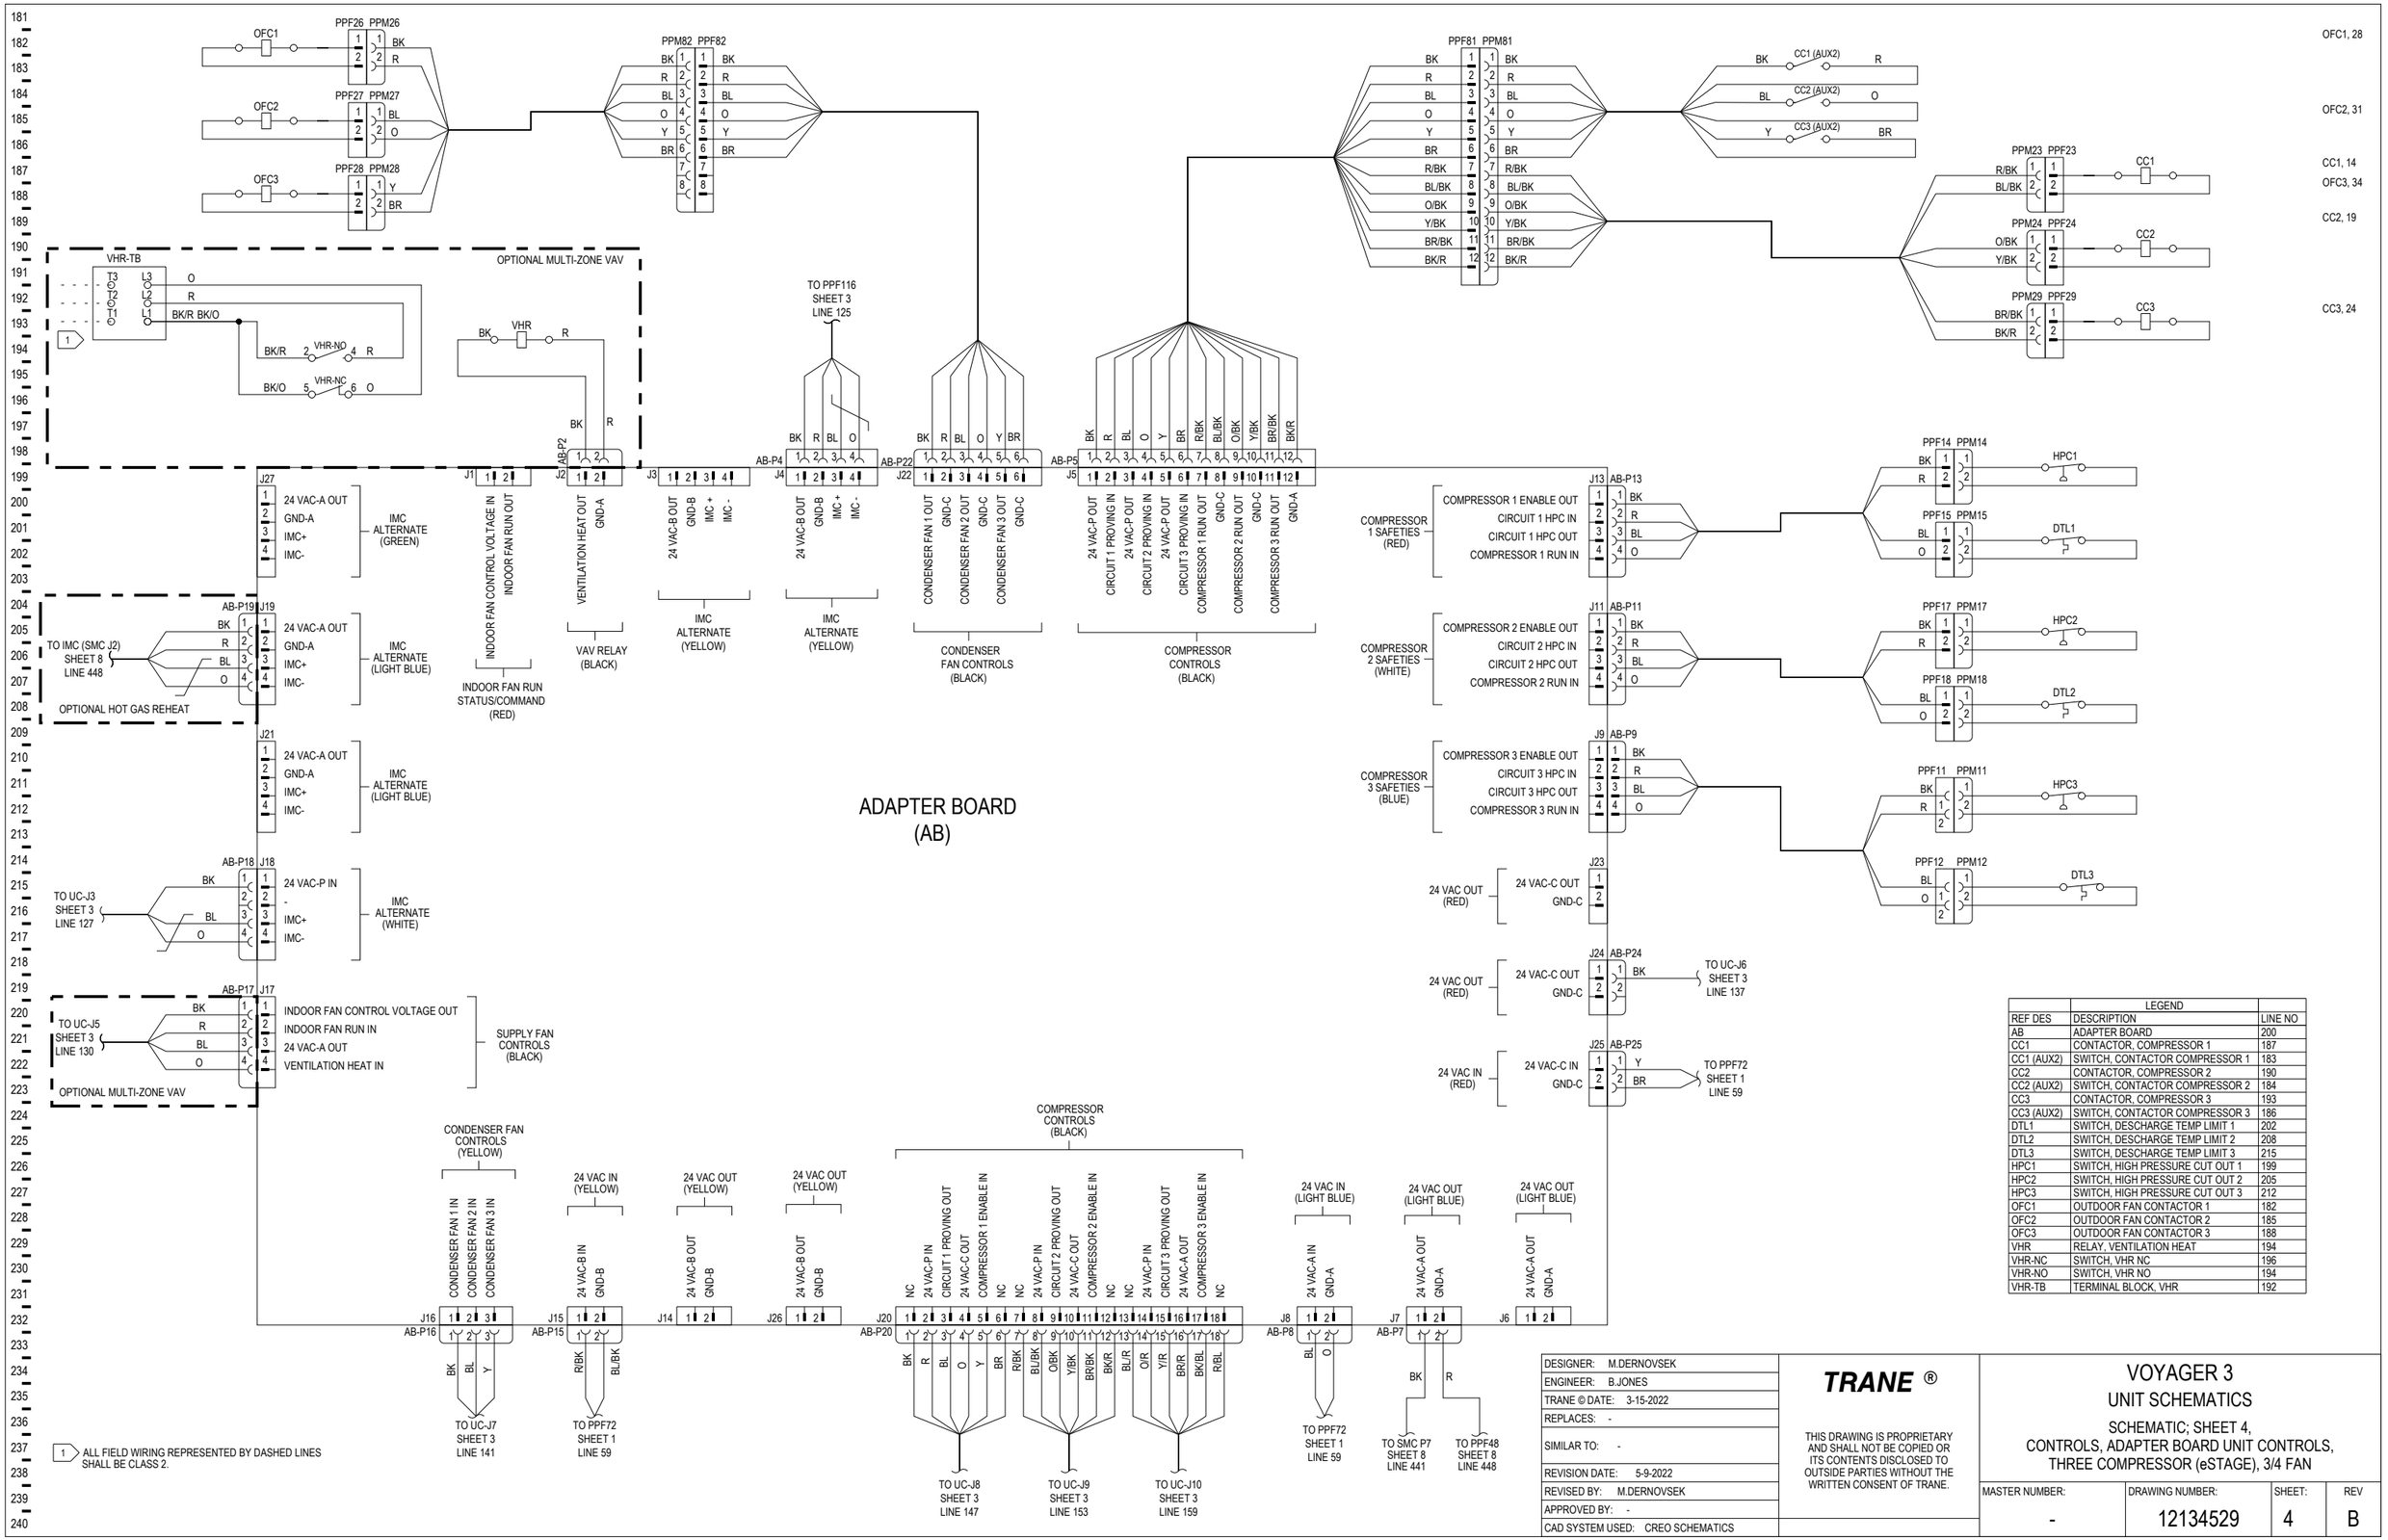


| LEGEND | | |
|---|---|---|
| REF DES | DESCRIPTION | LINE NO |
| AB | ADAPTER BOARD | 200 |
| CC1 | CONTACTOR, COMPRESSOR 1 | 187 |
| CC1 (AUX2) | SWITCH, CONTACTOR COMPRESSOR 1 | 183 |
| CC2 | CONTACTOR, COMPRESSOR 2 | 190 |
| CC2 (AUX2) | SWITCH, CONTACTOR COMPRESSOR 2 | 184 |
| CC3 | CONTACTOR, COMPRESSOR 3 | 193 |
| CC3 (AUX2) | SWITCH, CONTACTOR COMPRESSOR 3 | 186 |
| DTL1 | SWITCH, DESCHARGE TEMP LIMIT 1 | 202 |
| DTL2 | SWITCH, DESCHARGE TEMP LIMIT 2 | 208 |
| DTL3 | SWITCH, DESCHARGE TEMP LIMIT 3 | 215 |
| HPC1 | SWITCH, HIGH PRESSURE CUT OUT 1 | 199 |
| HPC2 | SWITCH, HIGH PRESSURE CUT OUT 2 | 205 |
| HPC3 | SWITCH, HIGH PRESSURE CUT OUT 3 | 212 |
| OFC1 | OUTDOOR FAN CONTACTOR 1 | 182 |
| OFC2 | OUTDOOR FAN CONTACTOR 2 | 185 |
| OFC3 | OUTDOOR FAN CONTACTOR 3 | 188 |
| VHR | RELAY, VENTILATION HEAT | 194 |
| VHR-NC | SWITCH, VHR NC | 196 |
| VHR-NO | SWITCH, VHR NO | 194 |
| VHR-TB | TERMINAL BLOCK, VHR | 192 |

| | |
|---|---|
| DESIGNER: | M.DERNOVSEK |
| ENGINEER: | B.JONES |
| TRANE © DATE: | 3-15-2022 |
| REPLACES: | - |
| SIMILAR TO: | - |
| REVISION DATE: | 5-9-2022 |
| REVISED BY: | M.DERNOVSEK |
| APPROVED BY: | - |
| CAD SYSTEM USED: | CREO SCHEMATICS |

**TRANE ®**

THIS DRAWING IS PROPRIETARY AND SHALL NOT BE COPIED OR ITS CONTENTS DISCLOSED TO OUTSIDE PARTIES WITHOUT THE WRITTEN CONSENT OF TRANE.

# VOYAGER 3
## UNIT SCHEMATICS

SCHEMATIC; SHEET 4,
CONTROLS, ADAPTER BOARD UNIT CONTROLS,
THREE COMPRESSOR (eSTAGE), 3/4 FAN

| MASTER NUMBER: | DRAWING NUMBER: | SHEET: | REV |
|---|---|---|---|
| - | 12134529 | 4 | B |