
RELEASED 12/Nov/2024 13:43:09 GMT

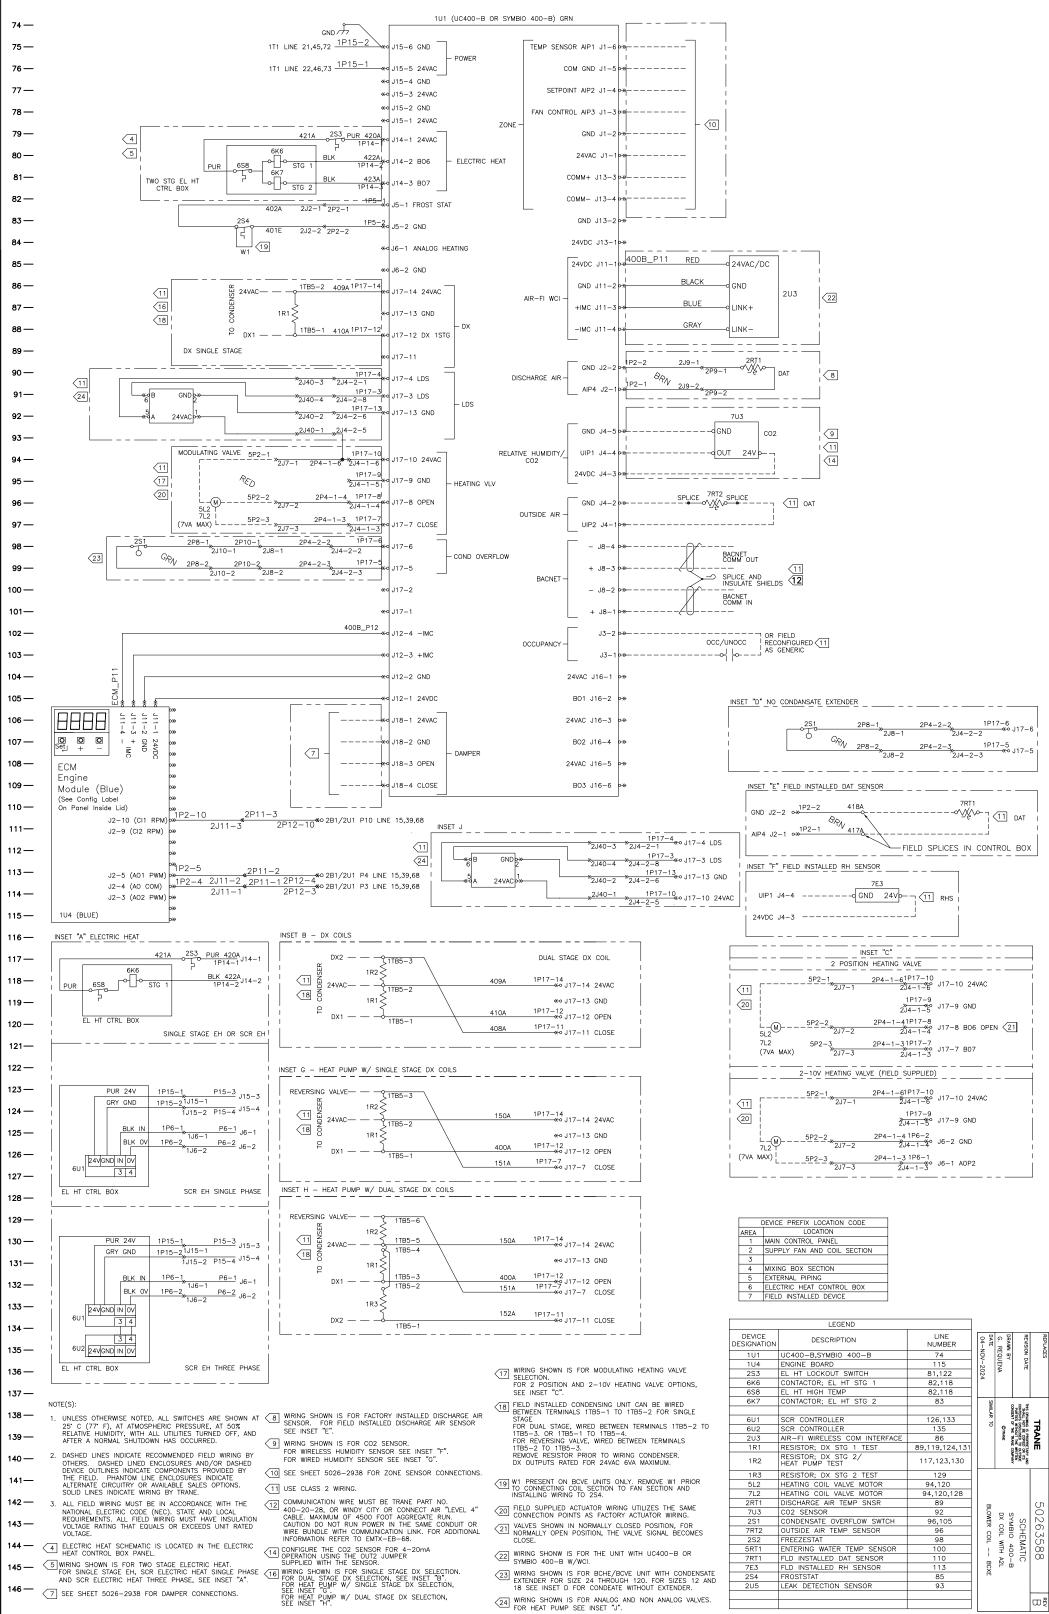

	DEVICE PREFIX LOCATION CODE
AREA	LOCATION
1	MAIN CONTROL PANEL
2	SUPPLY FAN AND COIL SECTION
3	
4	MIXING BOX SECTION
5	EXTERNAL PIPING
6	ELECTRIC HEAT CONTROL BOX
7	FIELD INSTALLED DEVICE

	LEGEND						
DEVICE DESIGNATION	DESCRIPTION	LINE NUMBER	04-NOV-2024	DATE	. R	DRAWN BY	
1U1	UC400-B,SYMBIO 400-B	74	þ		REQUENA	9	
1U4	ENGINE BOARD	115			Ē	Ì	
2S3	EL HT LOCKOUT SWITCH	81,122	N _N		Þ		
6K6	CONTACTOR; EL HT STG 1	82,118	1				
6S8	EL HT HIGH TEMP	82,118					
6K7	CONTACTOR; EL HT STG 2	83		ŝ		_	~
				SIMILAR		- Nor	R
6U1	SCR CONTROLLER	126,133		R TO		NT O	
6U2	SCR CONTROLLER	135		0	OTRANE	1	SHALL NOT BE COPIED CONTENTS DISCLOSED TO PARTIES WITHOUT THE
2U3	AIR-FI WIRELESS COM INTERFACE	86			NA NA	TRA	188
1R1	RESISTOR; DX STG 1 TEST	89,119,124,131				Ř	#38 \$29
1R2	RESISTOR; DX STG 2/ HEAT PUMP TEST	117,123,130				MPANY	WRITIEN
1R3	RESISTOR; DX STG 2 TEST	129					
5L2	HEATING COIL VALVE MOTOR	94,120					
7L2	HEATING COIL VALVE MOTOR	94,120,128					
2RT1	DISCHARGE AIR TEMP SNSR	89		m			
7U3	CO2 SENSOR	92		õ	D	w	
2S1	CONDENSATE OVERFLOW SWTCH	96,105		BLOWER COIL	DX COIL WITH	SYMBIO	Ś
7RT2	OUTSIDE AIR TEMP SENSOR	96		õ	ğ	B	SCHEMATIC
2S2	FREEZESTAT	98		₽	≤		F
5RT1	ENTERING WATER TEMP SENSOR	100		1	Ŧ	400	A
7RT1	FLD INSTALLED DAT SENSOR	110		1	A2L	U B B	ō
7E3	FLD INSTALLED RH SENSOR	113		BCXE	ř	Φ	
2S4	FROSTSTAT	85		ш			
2U5	LEAK DETECTION SENSOR	93					
			_	_	_	_	_