



301
302
303
304
305
306
307
308
309
310
311
312
313
314
315
316
317
318
319
320
321
322
323
324
325
326
327
328
329
330
331
332
333
334
335
336
337
338
339
340
341
342
343
344
345
346
347
348
349
350
351
352
353
354
355
356
357
358
359
360

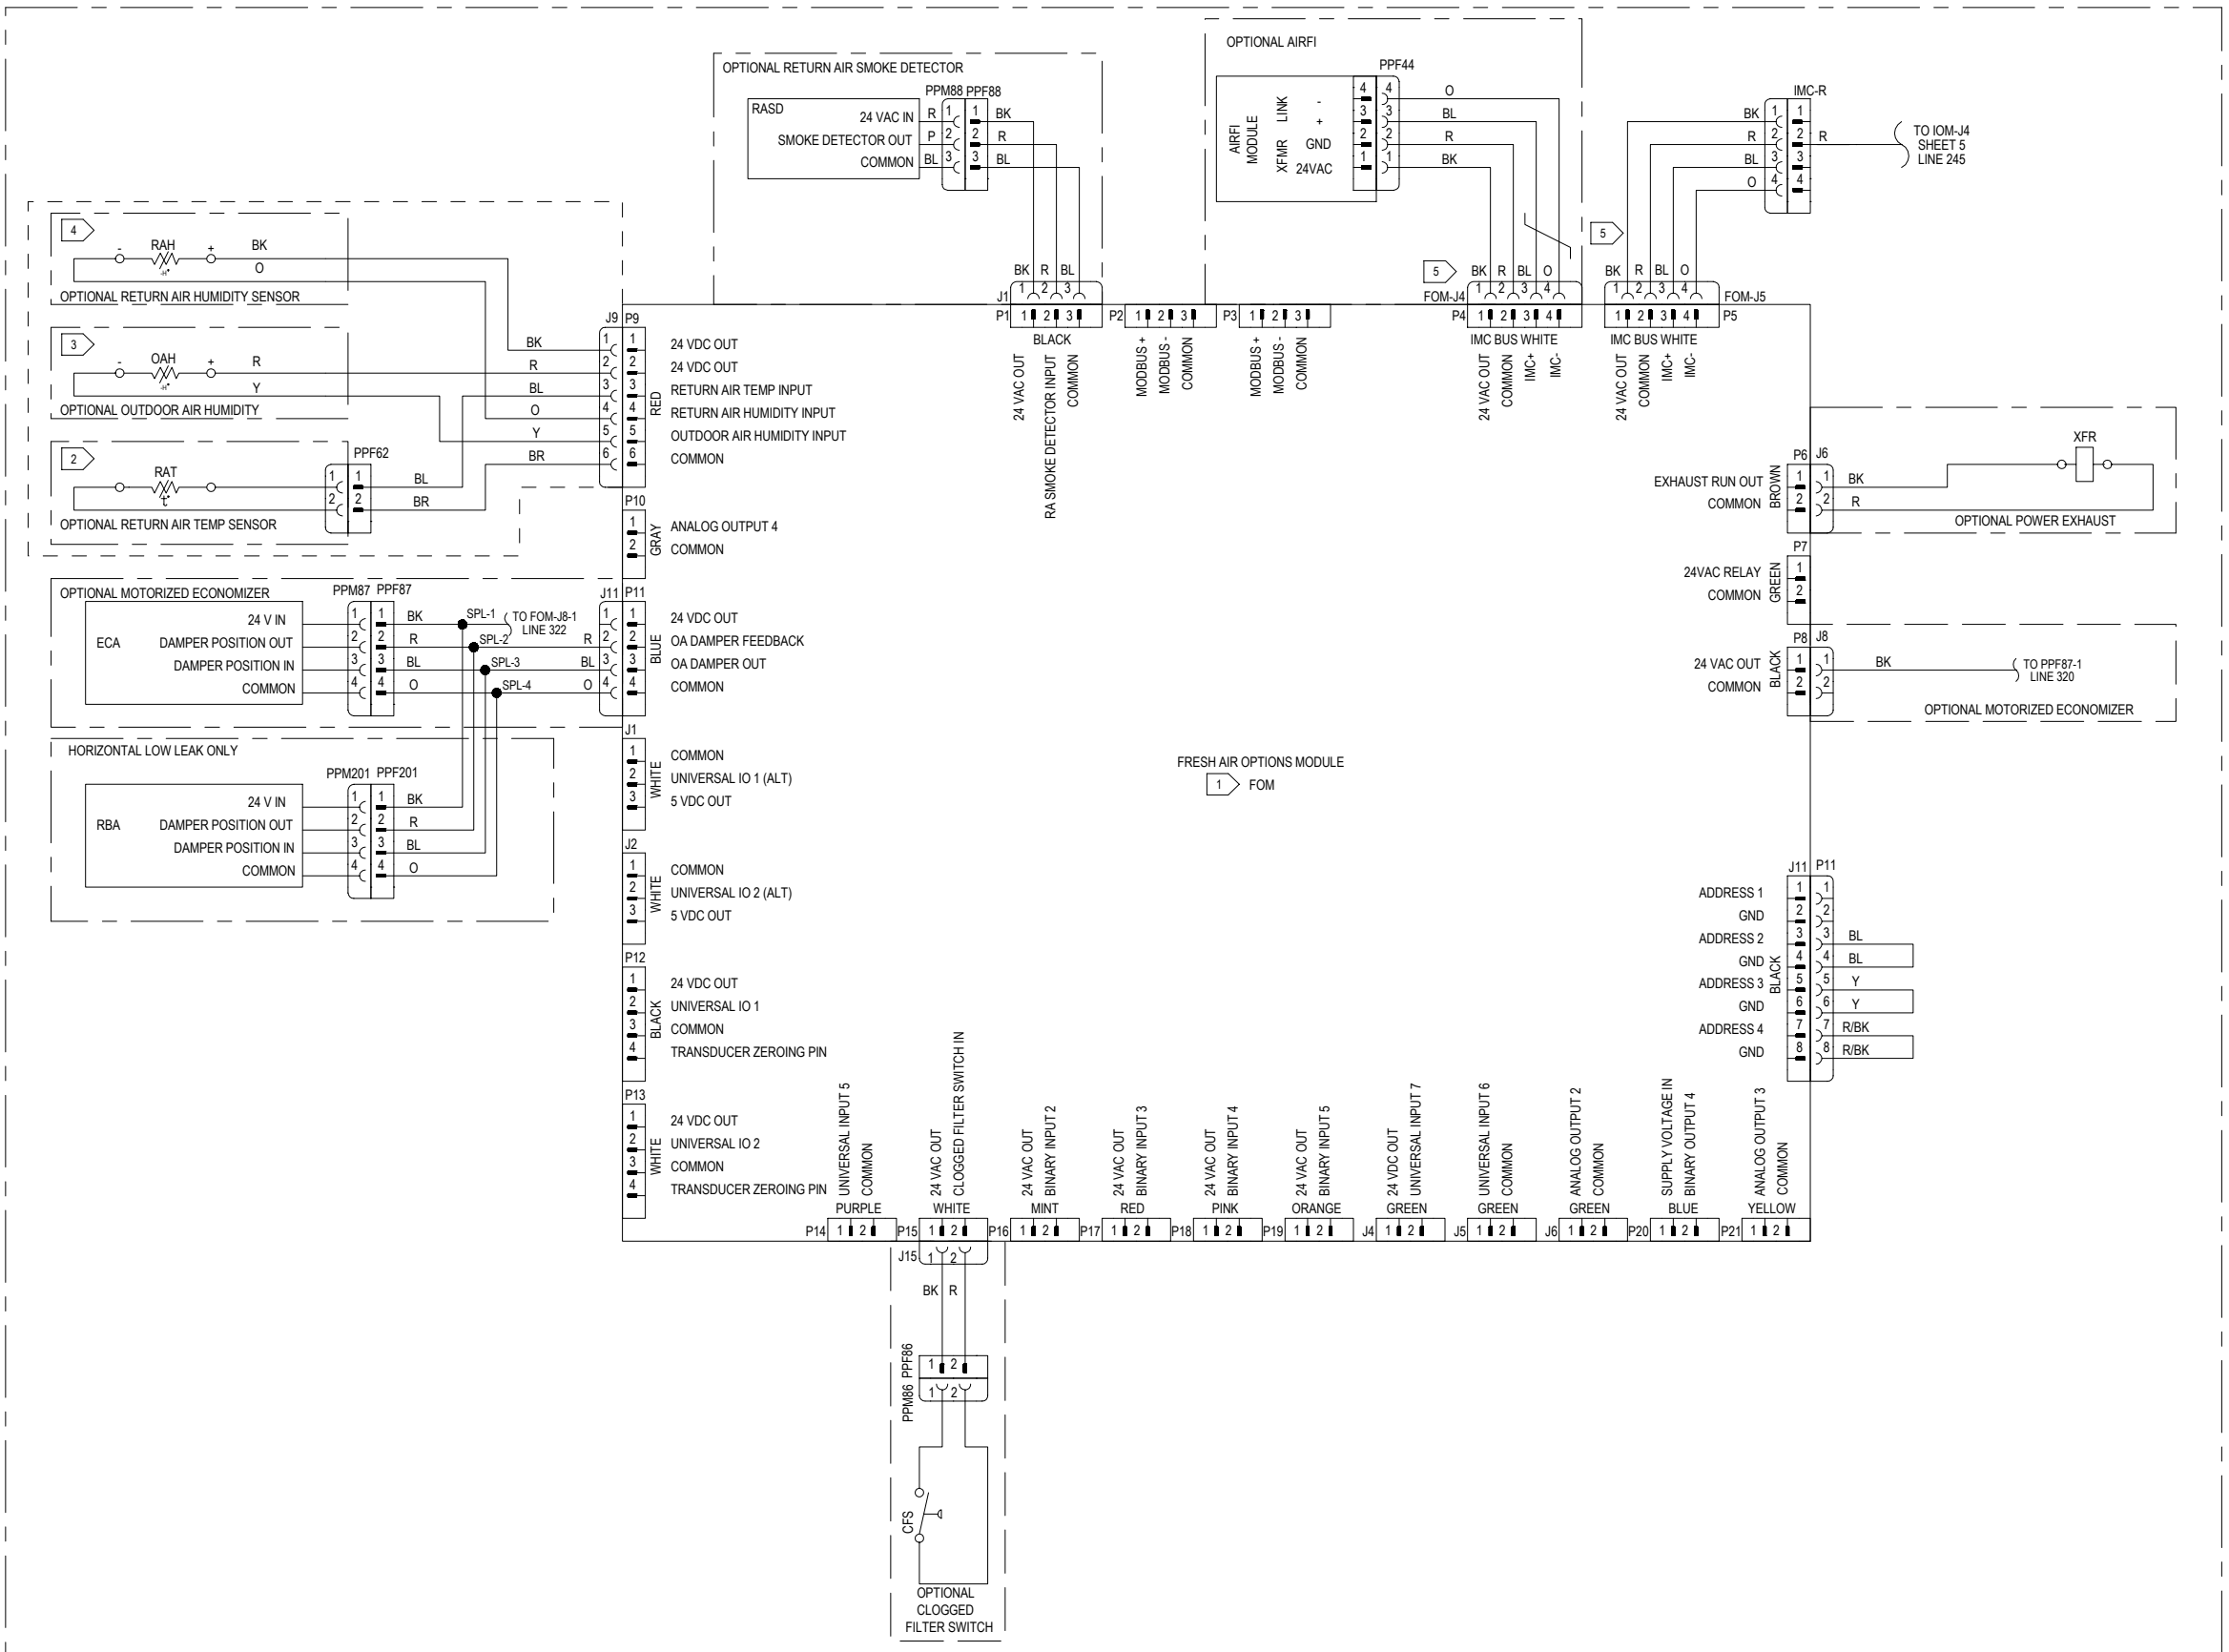

LEGEND		
REF DES	DESCRIPTION	LINE NO
AIRFI	AIRFI MODULE-INSET A	332
AIRFI	AIRFI MODULE	304
CFS	SWITCH - CLOGGED FILTER	349
ECA	ACTUATOR - ECONOMIZER	321
FOM	MODULE - FRESH AIR OPTIONS	312
OAH	SENSOR - OUTDOOR AIR HUMIDITY	313
RAH	SENSOR - RETURN AIR HUMIDITY	309
RASD	SENSOR - RETURN AIR SMOKE DETECTOR	305
RAT	SENSOR - RETURN AIR TEMP	317
RBA	ACTUATOR - ECONOMIZER, LOW LEAK	327
XFR	CONTACTOR - POWER EXHAUST	316

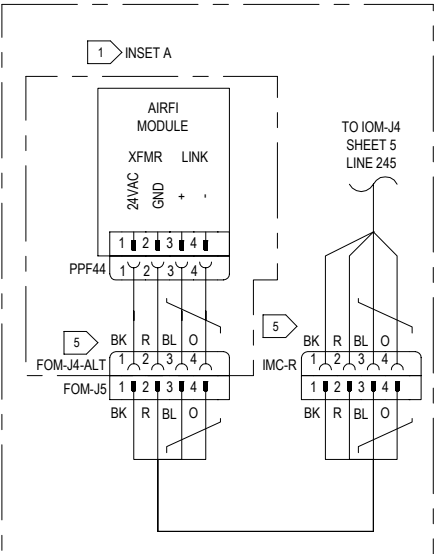

- 1 FRESH AIR OPTIONS MODULE ONLY PRESENT ON CERTAIN UNIT CONFIGURATIONS. SEE INSET "A" FOR UNITS WITHOUT FRESH AIR OPTIONS MODULE
- 2 RETURN AIR TEMP SENSOR PRESENT ON UNITS WITH DIFFERENTIAL DRY BULB, REFERENCE ENTHALPY, AND COMPARATIVE ENTHALPY CONTROL
- 3 OUTDOOR AIR HUMIDITY SENSOR PRESENT ON UNITS WITH REFERENCE ENTHALPY AND COMPARATIVE ENTHALPY CONTROL
- 4 RETURN AIR HUMIDITY SENSOR PRESENT ON UNITS COMPARATIVE ENTHALPY CONTROL
- 5 IF FOM IS PRESENT, AIRFI MODULE HARNESS CONNECTOR ATTACHES TO FOM. SEE INSET A FOR AIRFI WIRING CONNECTIONS WHEN FOM IS NOT PRESENT. IF FOM IS NOT PRESENT, CONNECT FOM-J4-ALT TO ALTERNATE HARNESS TO FOM-J5.

DESIGNER:	A. WAELE
ENGINEER:	B. JONES
TRANE © DATE:	29-SEP-2021
REPLACES:	
SIMILAR TO:	
REVISION DATE:	11/22/2024
REVISED BY:	T. VON NEUPERT
APPROVED BY:	D. MACVICAR
CAD SYSTEM USED:	CREO SCHEMATICS

TRANE®

THIS DRAWING IS PROPRIETARY AND SHALL NOT BE COPIED OR ITS CONTENTS DISCLOSED TO OUTSIDE PARTIES WITHOUT THE WRITTEN CONSENT OF TRANE.

PRECEDENT
UNIT SCHEMATIC
SCHEMATIC; SHEET 6
CONTROLS
FRESH AIR OPTIONS

MASTER NUMBER:	DRAWING NUMBER:	SHEET:	REV
	12134438	6	F